
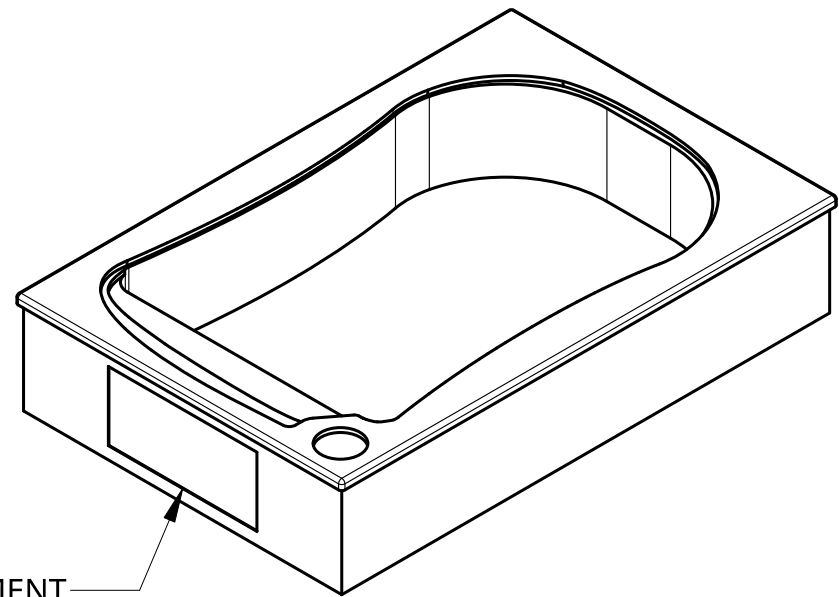


2

1

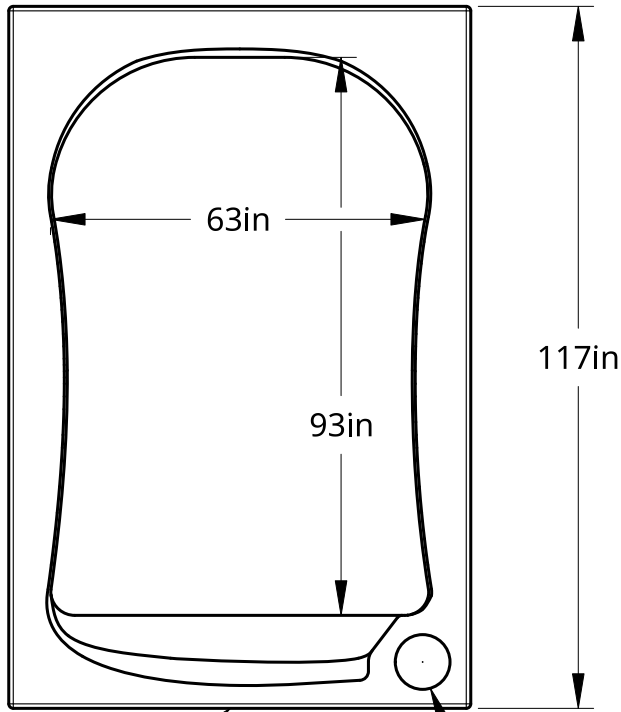

EQUIPMENT

EQUIPMENT


FILTER

Notes:

1. MUST BE PLACED ON HARD LEVEL SURFACE
2. ALL WORK MUST BE DONE TO LOCAL CODE/ORDINANCES
3. EQUIPMENT CAN BE LOCATED IN DIFFERENT LOCATIONS - CONSULT ROYAL SPA REP
4. PROPER IN ROOM HVAC WILL NEED TO BE INSTALLED TO ACCOMMODATE FOR HUMIDITY FROM OPEN TANK

Electrical Requiements:

1. 220V 20AMP, 3 WIRE WITH GROUND, GFI PROTECTED
2. HUBBLE L14-30 RECEPTICLE OR EQUIVALENT

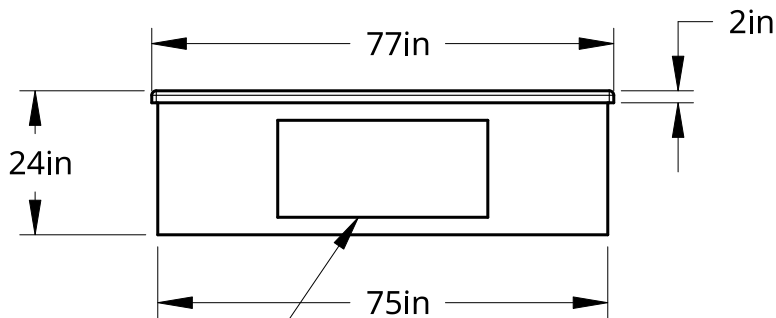

EQUIPMENT



TITLE			
FLOAT ROOM			
SIZE	DWG NO.	REV.	
A			
SCALE	WEIGHT	SHEET	1 of 1
1:32			

2

1

B

B

A

A